

# TET2500 Series

## AC-DC / HVDC Front-End Power Supplies

The TET2500-12-086 Series is a 2500 Watt AC-DC power-factor-corrected (PFC) and DC/DC power supply that converts standard AC mains power or high voltage DC bus voltages into a main output of 12 VDC for powering intermediate bus architectures (IBA) in high performance and reliability servers, routers, and network switches.

The TET2500-12-086 Series meets international safety standards and displays the CE-Mark for the European Low Voltage Directive (LVD).



### Key Features & Benefits

- Best-in-class, Meet Titanium efficiency
- Wide input voltage range: 180 - 264 VAC / 2500 W, 90 - 180 VAC /1250 W
- AC input with power factor correction
- Always-on 24 W standby output (12 V / 2 A)
- Hot-plug capability
- Parallel operation with active current sharing thru analog bus
- Full digital controls for improved performance
- High density design: 62 W/in<sup>3</sup>
- Small form factor: 86 x 40.0 x 195 mm (7.68 x 3.39 x 1.57 in)
- Up to 400 kHz
- I2C communication interface with Power Management Bus protocol for monitoring, control, and firmware update via bootloader
- Overtemperature, output overvoltage and overcurrent protection
- RoHS Compliant
- Status LED with fault signaling
- US patents



### Applications

- High Performance Servers
- Routers
- Switches



### 1. ORDERING INFORMATION

TET	2500	-	12	-	086	N	A	Option Code
<b>Product Family</b>	<b>Power Level</b>	<b>Dash</b>	<b>V1 Output</b>	<b>Dash</b>	<b>Width</b>	<b>Airflow</b>	<b>Input</b>	
TET Front-End	2500 W		12 V		86 mm	N: Normal <sup>1)</sup> R: Reverse <sup>2)</sup>	A: AC	Blank: Standard model

- 1) Rear to front
- 2) Front to rear

### 2. OVERVIEW

The TET2500-12-086 Series is a fully DSP controlled, highly efficient front-end power supply. It incorporates resonant-soft-switching technology and interleaved power trains to reduce component stresses, providing increased system reliability and very high efficiency. With a wide input operating voltage range and minimal linear derating of output power with respect to ambient temperature, the TET2500-12-86NA maximizes power availability in demanding server, switch, and router applications. The power supply is fan cooled and ideally suited for server integration with a matching airflow path.

The PFC stage is digitally controlled using a state-of-the-art digital signal processing algorithm to guarantee best efficiency and unity power factor over a wide operating range.

The DC-DC stage uses soft switching resonant techniques in conjunction with synchronous rectification. An active OR-ing device on the output ensures no reverse load current and renders the supply ideally suited for operation in redundant power systems. The always-on +12V standby power provides power to external power distribution and management controllers. Its protection with an active OR-ing device provides for maximum reliability.

Status information is provided with front-panel LED. In addition, the power supply can be monitored and controlled (i.e. fan speed setpoint) via I2C communication interface with Power Management Bus protocol. It allows full monitoring of the supply, including input and output voltage, current, power, and inside temperatures. The same I2C bus supports the bootloader to allow field update of the firmware in the DSP controllers.

Cooling is managed by a fan, controlled by the DSP controller. The fan speed is adjusted automatically depending on the actual power demand and supply temperature and can be overridden through the I2C buses.

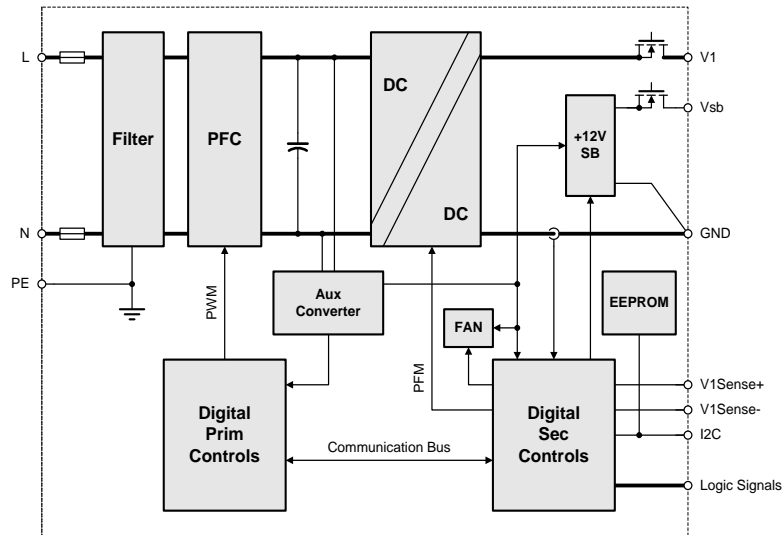


Figure 1. TET2500-12-086 Series Block Diagram

### 3. ABSOLUTE MAXIMUM RATINGS

Stresses in excess of the absolute maximum ratings may cause performance degradation, adversely affect long-term reliability and cause permanent damage to the supply.

PARAMETER	CONDITIONS / DESCRIPTION	MIN	MAX	UNITS
$V_i\ maxc$	Maximum Input	Continuous	264	VAC



## 4. INPUT

General Condition:  $T_A = 0...+45\text{ }^\circ\text{C}$ , unless otherwise noted.

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
$V_{i\ nom}$	AC Nominal Input Voltage	100	230	240	VAC
$V_i$	AC Input Voltage Ranges	Normal operating ( $V_{i\ min}$ to $V_{i\ max}$ )		264	VAC
$V_{i\ nom\ DC}$	DC Nominal Input Voltage	Rated HVDC		240	VDC
$V_{i\ DC}$	DC Input Voltage Ranges	Normal operating ( $V_{i\ min}$ to $V_{i\ max}$ )		300	VDC
$V_{i\ derated}$	Derated Input Voltage Range	See section 10.3		180	VAC
$I_{i\ max}$	Max Input Current	$V_i > 200\ \text{VAC}, >100\ \text{VAC}$		15	$A_{rms}$
$I_{i\ p}$	Inrush Current Limitation	$V_{i\ min}$ to $V_{i\ max}, T_{NTC} = 25^\circ\text{C}$ (See Figure 2)		35	$A_p$
$F_i$	Input Frequency	47	50/60	63	Hz
$PF$	Power Factor	$V_{i\ nom}, 50\text{Hz}, > 0.2\ I_{i\ nom}$		0.96	W/VA
$V_{i\ on}$	Turn-on Input Voltage <sup>2)</sup>	Ramping up		90	VAC
$V_{i\ off}$	Turn-off Input Voltage <sup>2)</sup>	Ramping down		85	VAC
$\eta$	Efficiency Without Fan	$V_i = 230\ \text{VAC}, 0.1 \cdot I_{x\ nom}, V_{x\ nom}, T_A = 25^\circ\text{C}$		94.55	%
		$V_i = 230\ \text{VAC}, 0.2 \cdot I_{x\ nom}, V_{x\ nom}, T_A = 25^\circ\text{C}$		95.9	
		$V_i = 230\ \text{VAC}, 0.5 \cdot I_{x\ nom}, V_{x\ nom}, T_A = 25^\circ\text{C}$		96.16	
		$V_i = 230\ \text{VAC}, I_{x\ nom}, V_{x\ nom}, T_A = 25^\circ\text{C}$		94.14	
$T_{hold}$	Hold-up Time	After last AC 45C degree(Worst case), $V_i > 11.7\text{V}, V_{SB}$ within regulation, $V_i = 230\ \text{VAC}, 0.7 P_{x\ nom}$		12	ms

<sup>2)</sup> The Front-End is provided with a typical hysteresis of 5 V during turn-on and turn-off within the ranges.

### 4.1 INPUT FUSE

Quick-acting 20 A input fuses (5.4 × 22.5 in mm) in series with the L-line inside the power supply protect against severe defects. The fuses are not accessible from the outside and are therefore not serviceable parts.

### 4.2 INRUSH CURRENT

The AC-DC power supply exhibits an X-capacitance of only 3.88  $\mu\text{F}$ , resulting in a low and short peak current, when the supply is connected to the mains. The internal bulk capacitor will be charged through a PTC which will limit the inrush current.

**NOTE:** Do not repeat plug-in / out operations below 5 sec interval time at maximum input, high temperature condition, or else the internal in-rush current limiting device PTC may not sufficiently cool down and excessive inrush current or component failure(s) may result.

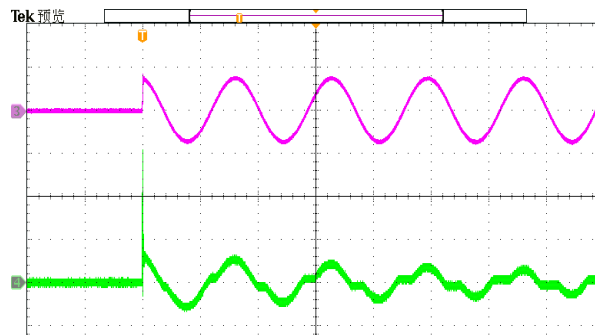


Figure 2. Inrush current,  $V_{in} = 264\text{Vac}, 90^\circ$   
 CH3:  $V_{in}$  (500V/div), CH4:  $I_{in}$  (10A/div)



### 4.3 INPUT UNDER-VOLTAGE

If the RMS value of input voltage (either AC or DC) stays below the input undervoltage lockout threshold  $V_{on}$ , the supply will be inhibited. Once the input voltage returns within the normal operating range, the supply will return to normal operation again.

### 4.4 POWER FACTOR CORRECTION

Power factor correction (PFC) (see *Figure 3*) is achieved by controlling the input current waveform synchronously with the input voltage. A fully digital controller is implemented giving outstanding PFC results over a wide input voltage and load ranges. The input current will follow the shape of the input voltage. If for instance the input voltage has a trapezoidal waveform, then the current will also show a trapezoidal waveform. At DC input voltage the PFC is still in operation, but the input current will be DC in this case.

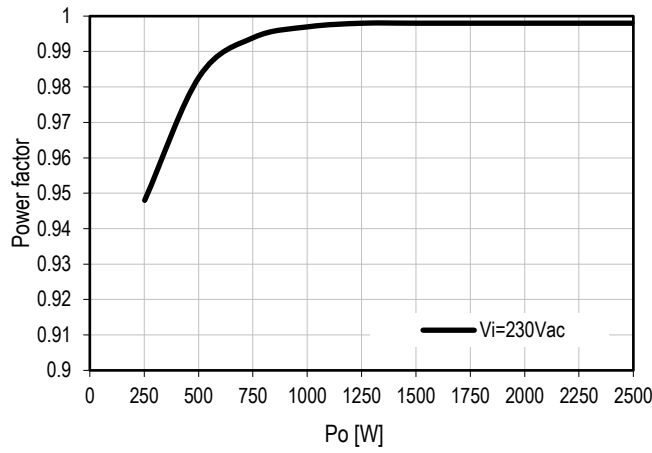


Figure 3. Power Factor vs. Load

### 4.5 EFFICIENCY

The high efficiency (see *Figure 4*) is achieved by using state-of-the-art GaN power devices in conjunction with soft-transition topologies minimizing switching losses and a full digital control scheme. Synchronous rectifiers on the output reduce the losses in the high current output path. The rpm of the fan is digitally controlled to keep all components at an optimal operating temperature regardless of the ambient temperature and load conditions.

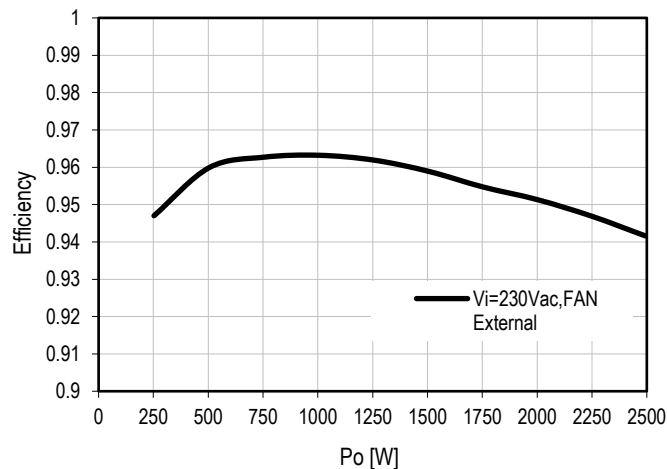


Figure 4. Efficiency vs. Load



## 5. OUTPUT

General Condition:  $T_a = 0 \dots +45^\circ\text{C}$  unless otherwise specified.

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
<b>Main Output <math>V_1</math></b>					
$V_1 \text{ nom}$	Nominal Output Voltage		12.3		VDC
$V_1 \text{ set}$	Output Setpoint Accuracy	$0.5 \cdot I_1 \text{ nom}, T_{\text{amb}} = 25^\circ\text{C}$		+0.5	% $V_1 \text{ nom}$
$dV_1 \text{ tot}$	Total Regulation	$V_1 \text{ min to } V_1 \text{ max}, 0 \text{ to } 100\% I_1 \text{ nom}, T_{a \text{ min to } T_{a \text{ max}}$		+2	% $V_1 \text{ nom}$
$P_1 \text{ nomll}$	Nominal Output Power	$V_1 = 12.3 \text{ VDC}, V_{\text{in}} < 180 \text{ VAC}$	1250		W
$I_1 \text{ nomll}$	Nominal Output Current	$V_1 = 12.3 \text{ VDC}, V_{\text{in}} < 180 \text{ VAC}$	102		A
$P_1 \text{ nom}$	Nominal Output Power	$V_1 = 12.3 \text{ VDC}, V_{\text{in}} > 180 \text{ VAC}$	2500		W
$I_1 \text{ nom}$	Nominal Output Current	$V_1 = 12.3 \text{ VDC}, V_{\text{in}} > 180 \text{ VAC}$	203		A
$I_1 \text{ ol}$	Short Time Over Load Current	$V_1 = 12.3 \text{ VDC}, V_{\text{in}} > 180 \text{ VAC}$ $T_{a \text{ min to } T_{a \text{ max}}}$ , maximum duration 20 ms (See Section 5.2)		244	A
$V_1 \text{ pp}$	Output Ripple Voltage	$V_1 \text{ nom}, I_1 \text{ nom}, 20\text{MHz BW}$ (See Section 5.1) (see Figure 11, 12)	90	120	mVpp
$dV_1 \text{ Load}$	Load Regulation	$V_1 = V_1 \text{ nom}, 0 - 100\% I_1 \text{ nom}$	140		mV
$dV_1 \text{ Line}$	Line Regulation	$V_1 = V_1 \text{ min} \dots V_1 \text{ max}$	0		mV
$dI_{\text{share}}$	Current Sharing	$(I_x - I_y) / I_{\text{tot}}, I > 25\% I_1 \text{ nom}$	-5	+5	%
$dV_{\text{dyn}}$	Dynamic Load Regulation	$\Delta I = 50\% I_1 \text{ nom}, I_1 = 5 \dots 100\% I_1 \text{ nom}$ , $dI/dt = 1\text{A}/\mu\text{s}$ , recovery within 1% of $V_1 \text{ nom}$ (see Figure 13, 14, 15, 16)	-0.6	0.6	V
$T_{\text{rec}}$	Recovery Time	(see Figure 13, 14, 15, 16)	0.5	1	ms
$t_{\text{AC } V_1}$	Start-up Time from AC	$V_1 = 10.8 \text{ VDC}$ (see Figure 5)	2.7	3	sec
$t_{V_1 \text{ rise}}$	Rise Time	$V_1 = 10 \dots 90\% V_1 \text{ nom}$ (see Figure 8)		30	ms
$C_{\text{Load}}$	Capacitive Loading	$T_a = 25^\circ\text{C}$		25,000	$\mu\text{F}$
<b>Standby Output <math>V_{\text{SB}}</math></b>					
$V_{\text{SB}} \text{ nom}$	Nominal Output Voltage		12.0		VDC
$V_{\text{SB}} \text{ set}$	Output Setpoint Accuracy	$0.5 \cdot I_{\text{SB}} \text{ nom}, T_{\text{amb}} = 25^\circ\text{C}$		+1	% $V_{\text{SB}} \text{ nom}$
$dV_{\text{SB}} \text{ tot}$	Total Regulation	$V_{\text{min to } V_{\text{max}}}, 0 \text{ to } 100\% I_{\text{SB}} \text{ nom}, T_{a \text{ min to } T_{a \text{ max}}$		+3	% $V_{\text{SB}} \text{ nom}$
$P_{\text{SB}} \text{ nom}$	Nominal Output Power	$V_{\text{SB}} = 12.0 \text{ VDC}$	24		W
$I_{\text{SB}} \text{ nom}$	Nominal Output Current	$V_{\text{SB}} = 12.0 \text{ VDC}$	2		A
$V_{\text{SB}} \text{ pp}$	Output Ripple Voltage	$V_{\text{SB}} \text{ nom}, I_{\text{SB}} \text{ nom}, 20 \text{ MHz BW}$ (See Section 5.1) (see Figure 9, 10)	60	120	mVpp
$dV_{\text{SB}}$	Droop	$0 - 100\% I_{\text{SB}} \text{ nom}$	180		mV
$dV_{\text{SB}} \text{ dyn}$	Dynamic Load Regulation	$\Delta I_{\text{SB}} = 50\% I_{\text{SB}} \text{ nom}, I_{\text{SB}} = 5 \dots 100\% I_{\text{SB}} \text{ nom}$ , $dI_{\text{SB}}/dt = 1 \text{ A}/\mu\text{s}$ , recovery within 1% of $V_1 \text{ nom}$	-0.6	0.6	V
$T_{\text{rec}}$	Recovery Time			0.5	ms
$t_{\text{AC } V_{\text{SB}}}$	Start-up Time from AC	$V_{\text{SB}} = 90\% V_{\text{SB}} \text{ nom}$ (see Figure 5)	2.5	3	sec
$t_{V_{\text{SB}} \text{ rise}}$	Rise Time	$V_{\text{SB}} = 10 \dots 90\% V_{\text{SB}} \text{ nom}$ (see Figure 7)		30	ms
$C_{\text{Load}}$	Capacitive Loading	$T_{\text{amb}} = 25^\circ\text{C}$		1,000	$\mu\text{F}$



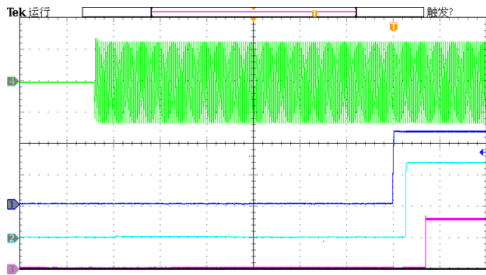


Figure 5. Turn-On AC Line 230VAC, full load (400ms/div)

CH1:  $V_{SB}$  (5V/div) CH2:  $V_i$  (5V/div)  
 CH3: PWOK (2V/div) CH4:  $V_{in}$  (250V/div)

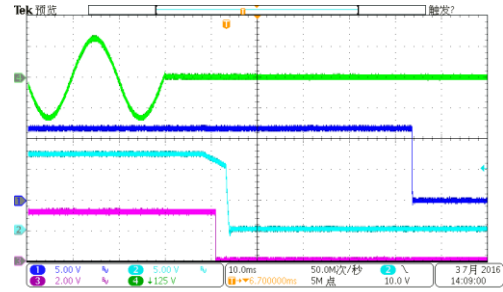


Figure 6. Turn-Off AC Line 230VAC, full load (10ms/div)

CH1:  $V_{SB}$  (5V/div) CH2:  $V_i$  (5V/div)  
 CH3: PWOK (2V/div) CH4:  $V_{in}$  (250V/div)

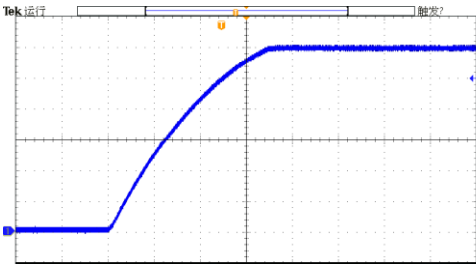


Figure 7. Turn-On AC Line 230VAC, full load (4ms/div)

CH1:  $V_{SB}$  (2V/div)

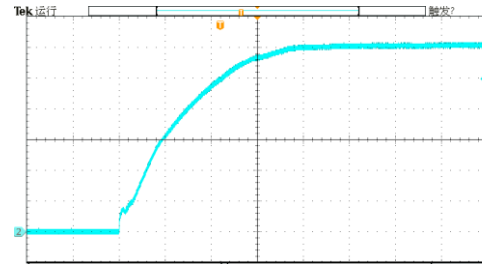


Figure 8. Turn-On AC Line 230VAC, full load (2ms/div)

CH2:  $V_i$  (2V/div)

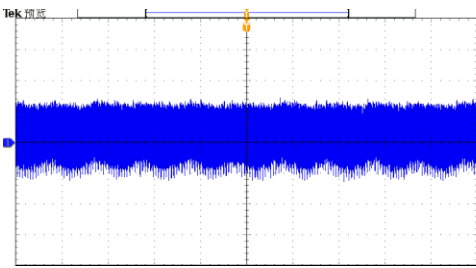


Figure 9.  $V_{SB}$  Ripple 230VAC, full load (10ms/div)

CH1:  $V_{SB}$  (20mV/div)

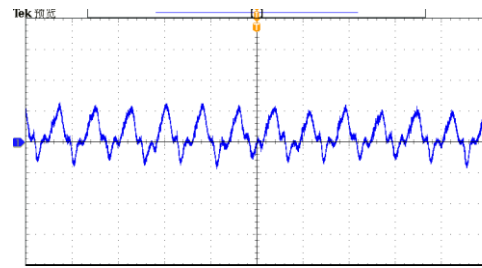


Figure 10.  $V_{SB}$  Ripple 230VAC, full load (10us/div)

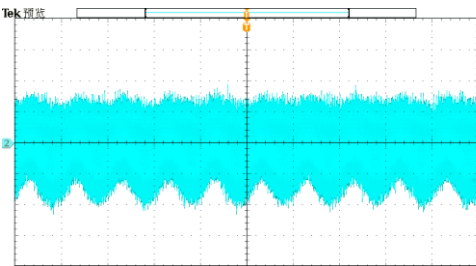


Figure 11.  $V_1$  Ripple 230VAC, full load (10ms/div)

CH2:  $V_i$  (20mV/div)

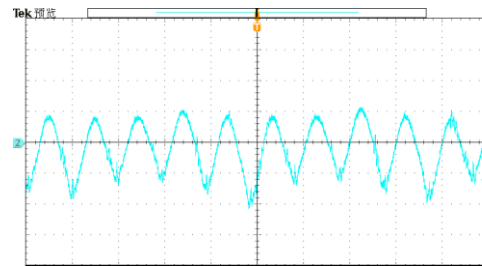


Figure 12.  $V_1$  Ripple 230VAC, full load (2us/div)

CH2:  $V_i$  (20mV/div)



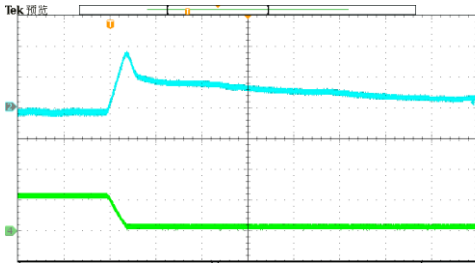


Figure 13. Load Transient V1, 111.65 to 10.15 A, 1A/uS (200 μs/div)  
CH2: V<sub>1</sub> (200mV/div) CH4: I<sub>1</sub> (100A/div)

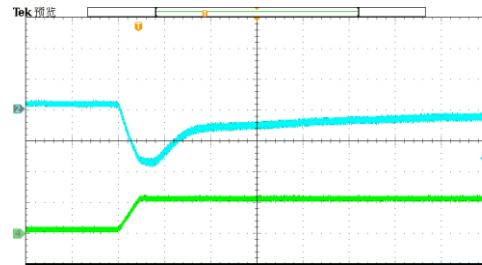


Figure 14. Load Transient V1, 10.15 to 111.65 A, 1A/uS (200 μs/div)  
CH2: V<sub>1</sub> (200mV/div) CH4: I<sub>1</sub> (100A/div)

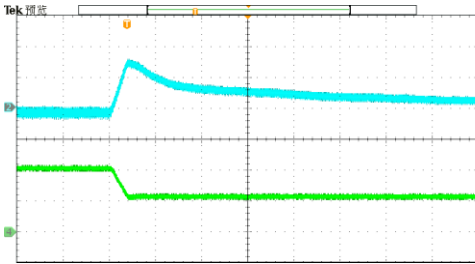


Figure 15. Load Transient V1, 203 to 101.5 A, 1A/uS (200 μs/div)  
CH2: V<sub>1</sub> (200mV/div) CH4: I<sub>1</sub> (100A/div)

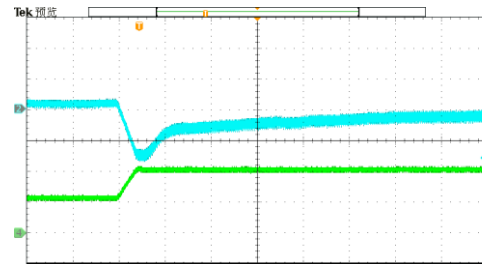


Figure 16. Load Transient V1, 101.5 to 203 A, 1A/uS (200 μs/div)  
CH2: V<sub>1</sub> (200mV/div) CH4: I<sub>1</sub> (100A/div)

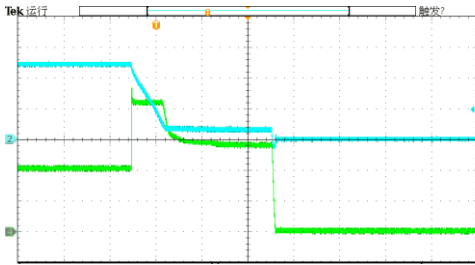


Figure 17. Short circuit on V1 (4ms/Div), Short with 400A  
CH2: V<sub>1</sub> (5V/div) CH4: I<sub>1</sub> (100A/div)

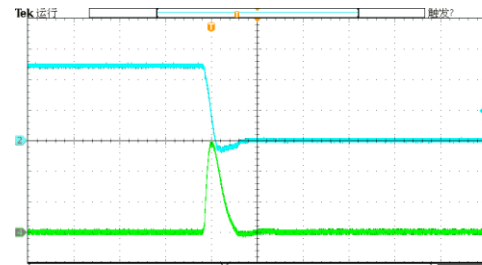


Figure 18. Short circuit on V1 (0.4ms/Div), Short without control  
CH2: V<sub>1</sub> (5V/div) CH4: I<sub>1</sub> (500A/div)

## 5.1 OUTPUT VOLTAGE RIPPLE

Ripple and noise shall be measured using the following methods:

- Outputs bypassed at the point of measurement with a parallel combination of 10μF tantalum capacitor in parallel with 0.1μF ceramic capacitors, referring the setup in Figure 19.
- The ripple voltage is measured with 20 MHz BWL.

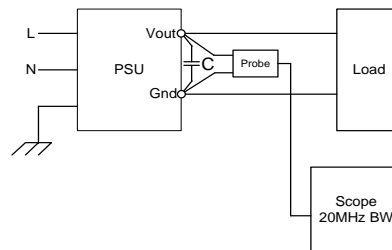


Figure 19. Output Ripple Test Setup



### 5.2 SHORT TIME OVERLOAD

The main output has the capability to allow load current up to 20% above the nominal output current rating for a maximum duration of 20ms. This allows the system to consume extended power for short time dynamic processes.

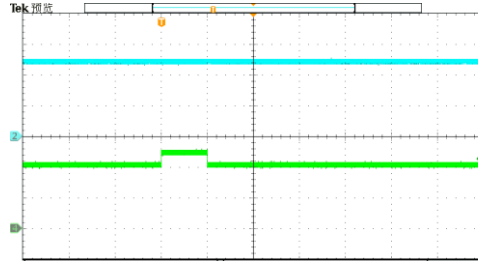


Figure 20. Short circuit on V1 (20ms/Div)  
 CH2: V<sub>i</sub> (5V/div) CH4: V<sub>in</sub> (100A/div)

### 5.3 OUTPUT GROUND / CHASSIS CONNECTION

The output return path serves as power and signal ground. All output voltages and signals are referenced to these pins. To prevent a shift in signal and voltage levels due to ground wiring voltage drop a low impedance ground plane should be used as shown in Figure 21. Alternatively, separated ground signals can be used as shown in Figure 22. In this case the two ground planes should be connected at the power supplies ground pins.

NOTE: Within the power supply the output GND pins are connected to the Chassis, which in turn is connected to the Protective Earth terminal on the AC inlet. Therefore, it is not possible to set the potential of the output return (GND) to any other than Protective Earth potential.

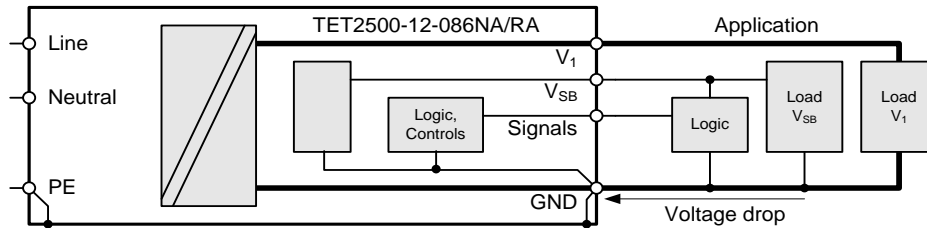


Figure 21. Common Low Impedance Ground Plane

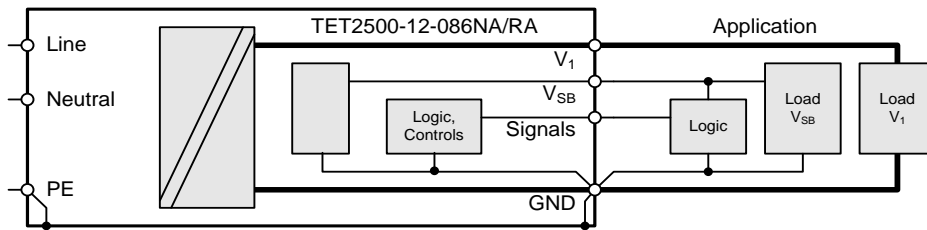


Figure 22. Separated Power and Signal Ground





## 6. PROTECTION SPECIFICATIONS

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT	
$F$	Input Fuse (Line)	Not user accessible, quick-acting (F)			$A_{rms}$	
$V_{1\text{ ov}}$	OV Threshold $V_1$	13.3	13.9	14.5	VDC	
$t_{\text{ov } V_1}$	OV Latch Off Time $V_1$				1 ms	
$V_{\text{SB ov}}$	OV Threshold $V_{\text{SB}}$	13.3	13.9	14.5	VDC	
$t_{\text{ov } V_{\text{SB}}}$	OV Latch Off Time $V_{\text{SB}}$				1 ms	
$I_{V_1\text{ lim}}$	Current Limitation $V_1$	$V_1 < 180\text{ VAC}, T_a < 45^\circ\text{C}$	107	112	117	A
		$V_1 < 180\text{ VAC}, T_a = 50^\circ\text{C}^{3)}$	97	101	105	
		$V_1 < 180\text{ VAC}, T_a = 55^\circ\text{C}^{3)}$	86	90	94	
		$V_1 > 180\text{ VAC}, T_a < 45^\circ\text{C}$	215	224	233	
		$V_1 > 180\text{ VAC}, T_a = 50^\circ\text{C}^{3)}$	193	201	209	
		$V_1 > 180\text{ VAC}, T_a = 55^\circ\text{C}^{3)}$	172	179	186	
$t_{V_1\text{ lim}}$	Current Limit Blanking Time	Time to latch off when in over current			20 ms	
$I_{V_1\text{ ol lim}}$	Current Limit During Short Time Overload $V_1$	Maximum duration 20 ms			244 A	
$I_{V_1\text{ sc}}$	Max Short Circuit Current $V_1$	$V_1 < 3\text{V}$			300 <sup>4)</sup> A	
$t_{V_1\text{ sc off}}$	Short Circuit Latch Off Time	Time to latch off when in short circuit (Short circuit current < 400 A)			10 ms	
		See Figure 17 (Short circuit current > 400 A)			0.2 ms	
		See Figure 18				
$I_{\text{SB lim}}$	Current Limitation $V_{\text{SB}}$	2.2	2.5	2.8	A	
$t_{\text{SB lim}}$	Current Limit Blanking Time	Time to hit hiccup when in over current			1 ms	

3) See Figure 24 and Table 1 for linear derating > 45°C

4) Limit set doesn't include effects of main output capacitive discharge.

### 6.1 OVERVOLTAGE PROTECTION

The TET2500-12-086 Series front-end provides a fixed threshold overvoltage (OV) protection implemented with a HW comparator for both the main and the standby output. Once an OV condition has been triggered on the main output, the supply will shut down and latch the fault condition. The latch can be unlocked by disconnecting the supply from the AC mains or by toggling the PSON\_L input. The standby output will continuously try to restart with a 1 s interval after OV condition has occurred.

### 6.2 UNDERVOLTAGE DETECTION

Both main and standby outputs are monitored. PWOK pin signal if the output voltage exceeds  $\pm 5\%$  of its nominal voltage.

The main output will latch off if the main output voltage when  $V_1$  falls below 11.2V (typically in an overload condition), the latch can be unlocked by disconnecting the supply from the AC mains or by toggling the PSON\_L input.

If the standby output leaves its regulation bandwidth for more than 10ms then the main output is disabled to protect the system, and the standby output will continuously try to restart with a 1s interval after UV condition has occurred.

### 6.3 CURRENT LIMITATION

#### MAIN OUTPUT

The main output current limitation level  $I_{V_1\text{ lim}}$  will decrease if the ambient (inlet) temperature increases beyond 45 °C (see Figure 24 and Table 1). Note that the current limitation on  $V_1$  will kick in at a current level approximately 10A-16A higher nominal output current than is shown.

The 2<sup>nd</sup> protection is a substantially rectangular output characteristic controlled by a software feedback loop. This protects the power supply and system during the 20ms blanking time of the static over current protection. If the output current is rising fast and reaches  $I_{V_1\text{ ol lim}}$ , the supply will immediately reduce its output voltage to prevent the output current from exceeding  $I_{V_1\text{ ol lim}}$ . When the output current is reduced below  $I_{V_1\text{ ol lim}}$ , the output voltage will return to its nominal value.

When the main output over current, the  $V_1$  will shut down and latch off. The latch can be cleared by recycling the input voltage or the PSON\_L input. A failure on the Main output will shut down only the Main output, while Standby continues to operate.



Asia-Pacific  
+86 755 298 85888

Europe, Middle East  
+353 61 49 8941

North America  
+1 866 513 2839

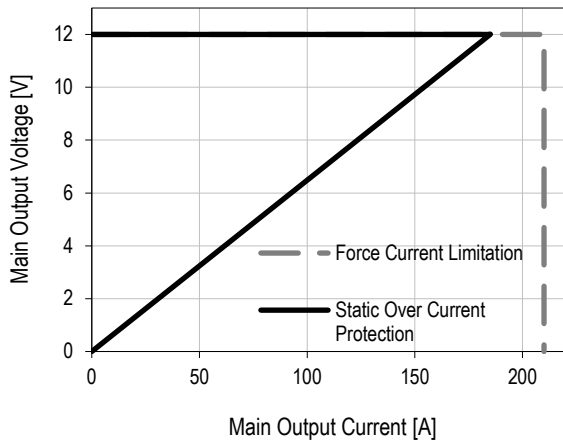


Figure 23. Current Limitation on  $V_1$  ( $V_i = 230VAC$ )

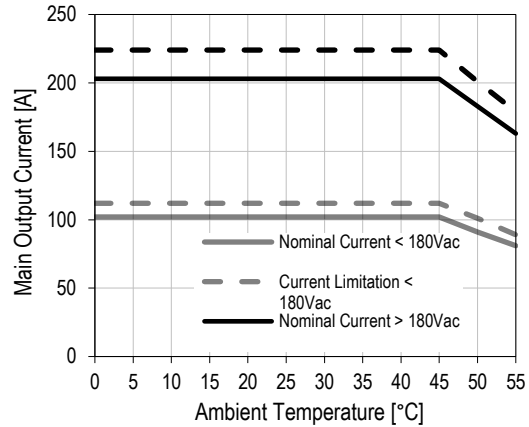


Figure 24. Derating on  $V_1$  vs  $T_a$  &  $V_{in}$

$V_{in}(Vac)$	$\leq 45^\circ C$ $I_{out\_Nom}(A)$	$\leq 45^\circ C$ $I_{out\_OCP}(A)$	$50^\circ C$ $I_{out\_Nom}(A)$	$50^\circ C$ $I_{out\_OCP}(A)$	$55^\circ C$ $I_{out\_Nom}(A)$	$55^\circ C$ $I_{out\_OCP}(A)$
90	102	112	91	101	81	89
100	102	112	91	101	81	89
110	102	112	91	101	81	89
120	102	112	91	101	81	89
130	102	112	91	101	81	89
140	102	112	91	101	81	89
150	102	112	91	101	81	89
160	102	112	91	101	81	89
170	102	112	91	101	81	89
175	203	224	183	201	163	179
180	203	224	183	201	163	179
190	203	224	183	201	163	179
200	203	224	183	201	163	179
210	203	224	183	201	163	179
220	203	224	183	201	163	179
270	203	224	183	201	163	179

Table1. Main Output Nominal Output Current  $I_{1\_nom}$  & Current Limitation  $I_{V1\_lim}$  vs Inlet Temperature (degC) &  $V_{in}(Vac)$

**STANDBY OUTPUT**

On the standby output a hiccup type over current protection is implemented. This protection will shut down the standby output immediately when standby current reaches or exceeds  $I_{SB\_lim}$ . After an off-time of 1s the output automatically tries to restart. If the overload condition is removed the output voltage will reach again its nominal value. At continuous overload condition the output will repeatedly trying to restart with 1s intervals. A failure on the Standby output will shut down both Main and Standby outputs.

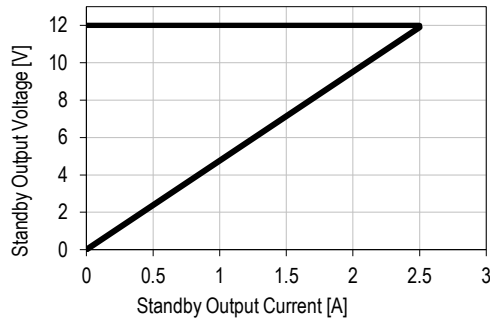


Figure 25. Current Limitation on  $V_{SB}$



## 7. MONITORING

PARAMETER		DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
$V_{1\text{ mon}}$	Input RMS Voltage	$V_{1\text{ min}} \leq V_1 \leq V_{1\text{ max}}$	-2.5		+2.5	%
$I_{1\text{ mon}}$	Input RMS Current	$I_1 > 6 A_{\text{rms}}$	-5		+5	%
		$I_1 \leq 6 A_{\text{rms}}$	-0.3		+0.3	$A_{\text{rms}}$
$P_{1\text{ mon}}$	True Input Power	$P_1 > 700 W$	-5		+5	%
		$P_1 \leq 700 W$	-35		+35	W
$V_{1\text{ mon}}$	V <sub>1</sub> Voltage		-2		+2	%
$I_{1\text{ mon}}$	V <sub>1</sub> Current	$I_1 > 30 A$	-2		+2	%
		$I_1 \leq 30 A$	-1		+1	A
$P_{o\text{ nom}}$	Total Output Power	$P_o > 200 W$	-5		+5	%
		$P_o \leq 200 W$	-10		+10	W
$V_{\text{SB mon}}$	Standby Voltage		-2		+2	%
$I_{\text{SB mon}}$	Standby Current	$I_{\text{SB}} \leq I_{\text{SB nom}}$	-0.2		+0.2	A

Table 2. Monitoring accuracy

## 8. SIGNALING AND CONTROL

### 8.1 ELECTRICAL CHARACTERISTICS (INPUT SIGNALS)

All Input signals versus signal ground SGND pin of output connector in PSU

PARAMETER	DESCRIPTION	MIN	NOM	MAX	UNIT
<i>PSKILL / PSON_L inputs</i>					
$V_L$	Input low level voltage		-0.2		0.5 V
$V_H$	Input high level voltage		2.0		5.25 V
$I_{L, H}$	Maximum input sink or source current				4 mA
$R_{\text{puPSKILL}}$	Internal pull up resistor to internal 3.3V on PSKILL			10	kΩ
$R_{\text{puPSON_L}}$	Internal pull up resistor to internal 3.3V on PSON_L			10	kΩ

Table 3. Input signals

#### 8.1.1 PSKILL INPUT

The PSKILL input is an active-high and normally a trailing pin in the connector and is used to disconnect the main output as soon as the power supply is being plugged out. This pin should be connected to SGND on the system. The standby output will remain on regardless of the PSKILL input state.

#### 8.1.2 PSON\_L INPUT

The PSON\_L is an internally pulled-up (3.3V) input signal to enable / disable the main output V1 of the front-end. This active-low pin is also used to clear any latched fault condition. Figure 26 shows PSON\_L circuit used in PSU and proposed connections.



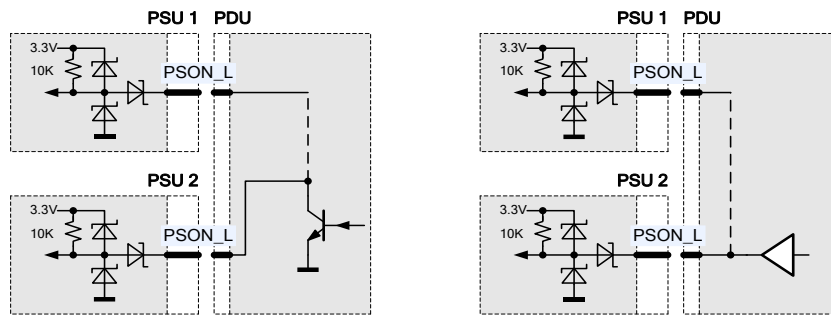


Figure 26. PSON\_L Connection

### 8.1.3 SENSE INPUTS

The main output has sense lines implemented to compensate for voltage drop on load wires in both positive and negative path. The maximum allowed voltage drop is 200 mV on the positive rail and 50 mV on the GND rail.

With open sense inputs the main output voltage will rise by 250 mV. Therefore, if not used, these inputs should be connected to the power output and GND at the power supply connector. The sense inputs are protected against short circuit. In this case the power supply will shut down.

## 8.2 ELECTRICAL CHARACTERISTICS (OUTPUT SIGNALS)

All Output signals versus signal ground SGND in PSU.

PARAMETER	DESCRIPTION		MIN	NOM	MAX	UNIT
<b>PWOK output</b>						
$V_{OL}$	Output low level voltage	V1 or VSB out of regulation $I_{sink}=400\mu A$	0		0.4	V
$V_{OH}$	Output high level voltage	V1 and VSB in regulation $I_{source}=200\mu A$	2.4		3.46	V
$I_{OL}$	Maximum Sink Current	PWOK = low			400	$\mu A$
$I_{OH}$	Maximum Source Current	PWOK = high			2	mA
$R_{puPWOK}$	Recommended external pull up resistor on PWOK at $V_{puPWOK} = 3.3 V$ $V_{puPWOK} = 5 V$		6.8 10	10 15		k $\Omega$
<b>ACOK output</b>						
$V_{OL}$	Output low level voltage	$I_{sink} < 4mA$	0		0.4	V
$V_{OH}$	Output open collector				External pull up VDD	V
$R_{puACOK}$	Recommended external pull up resistor on ACOK at $V_{puACOK} = 3.3 V$			10		k $\Omega$
<i>Low level output</i>	Input voltage is not within range for PSU to operate					
<i>High level output</i>	Input voltage is within range for PSU to operate					
<b>SMB_ALERT_L output</b>						
$V_{OL}$	Output low level voltage	$I_{sink} < 4 mA$	0		0.4	V
$V_{OH}$	Output open collector				External pull up VDD	V
$R_{puSMB\_ALERT\_L}$	Recommended external pull up resistor on SMB_ALERT_L at $V_{puSMB\_ALERT\_L} = 3.3V$			10		k $\Omega$
<i>Low level output</i>	PSU in warning or failure condition					
<i>High level output</i>	PSU is ok					

PRESENT_L output					
$V_{OL}$	Output low level voltage	$I_{sink} < 4 \text{ mA}$	0	0.4	V
$V_{OH}$	N.A	This pin is shorted to SGND in PSU			V
$R_{puPRESENT\_L}$	Recommended external pull up resistor on PRESENT_L at $V_{puPRESENT\_L} = 3.3V$		10		k $\Omega$
Low level output	PSU is present				
High level output	PSU is not present				

Table 4. Output signals

### 8.2.1 PWOK

PWOK is a power OK signal and will be pulled HIGH by the power supply to indicate that all the outputs are within the regulation limits of the power supply. When any output voltage falls below regulation limits or when AC power has been removed for a time sufficiently long so that power supply operation is no longer guaranteed, PWOK will be de-asserted to a LOW state.

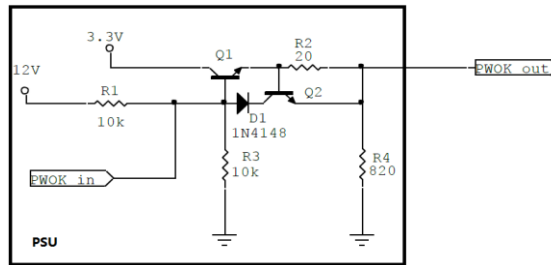


Figure 27. PWOK circuit in PSU

### 8.2.2 ACOK

The ACOK is an open collector output that requires an external pull-up to a maximum of 12V indicating whether the input is within the range the power supply can use and turn on. A 15V zener diode is added on this signal pin versus signal ground SGND to protect internal circuits from negative and high positive voltage. The ACOK signal is active-high.

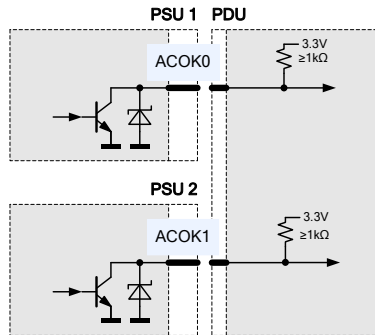


Figure 28. ACOK Connection

### 8.2.3 SMB\_ALERT\_L

The SMB\_ALERT\_L signal indicates that the power supply is experiencing a problem that the system agent should investigate. This is a logical OR of the Shutdown and Warning events. It is asserted (pulled Low) at Shutdown or Warning events such as reaching temperature warning/shutdown threshold of critical component, general failure, over-current, over-voltage, under-voltage or low-speed of failed fan. This signal may also indicate the power supply is operating in an environment exceeding the specified limits. This signal is to be asserted in parallel with LED turning solid Amber.

The power supply shall assert the over temperature SMB\_ALERT\_L signal when a hot spot or inlet temperature sensor crosses a warning threshold. The inlet temperature warning threshold must be set at 57.5°C(NA) and 62°C(RA), preventing exhaust air and cord temperatures exceeding safety ratings. The warning gets deserted once inlet air temperature returns into specified operating temperature range. Fan speed control algorithm shall ramp up the fan speed to the maximum prior to the SMB\_ALERT\_L insertion. A 15V zener diode is added on this signal pin versus signal ground SGND to protect internal circuits from negative and high positive voltage.



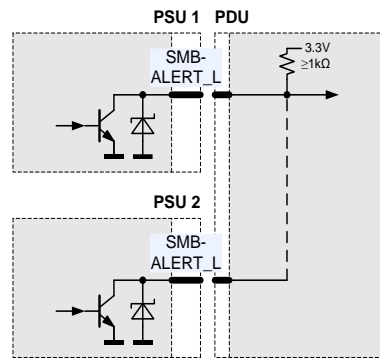


Figure 29. SMB\_ALERT\_L Connection

### 8.2.4 PRESENT\_L OUTPUT

The PRESENT\_L pin is wired to internal SGND within the power supply. This pin does indicate that there is a power supply present in this system slot. An external pull-up resistor has to be added within the application. Current into PRESENT\_L should not exceed 4 mA to guarantee a low level voltage if power supply is seated.

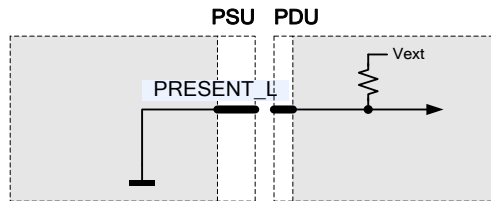


Figure 30. PRESENT\_L Signal Pin

## 8.3 ELECTRICAL CHARACTERISTICS (BIDIRECTIONAL SIGNALS)

### 8.3.1 CURRENT SHARE

All Output signals versus signal ground SGND in PSU

The TET front-ends have an active current share scheme implemented for V1. All the ISHARE current share pins need to be interconnected in order to activate the sharing function. If a supply has an internal fault or is not turned on, it will disconnect its ISHARE pin from the share bus. This will prevent dragging the output down (or up) in such cases.

The current share function uses an analog bus to transmit and receive current share information. The controller implements a Master/Slave current share function. The power supply providing the largest current among the group is automatically the Master. The other supplies will operate as Slaves and increase their output current to a value close to the Master by slightly increasing their output voltage. The voltage increase is limited to +250 mV. The output will share within 5% at full load.

ISHARE pins must be interconnected without any additional components. This in-/output has a 15 V zener diode as a protection device and is disconnected from internal circuits when the power supply is switched off.

The 12VSB output is not required to actively share current between power supplies (passive sharing).

No of paralleled PSUs	Maximum available power on main 12V without redundancy	Maximum available power on main 12V with n+1 redundancy	Maximum available power on standby output
1	2500 W	-	24 W
2	4875 W	2500 W	24 W
3	7250 W	4875 W	24 W
4	9625 W	7250 W	24 W
5	12000 W	9625 W	24 W
6	14375 W	12000 W	24 W

Table 5. Power Available When PSU in Redundant Operation

## 8.4 FRONT LEDS

The front-end has 1 front LED showing the status of the supply. LED is bi-colored: green and yellow, and indicates DC power presence or fault situations. For the position of the LED see *Table* lists the different LED status.

OPERATING CONDITION	LED State
Output ON and OK	Solid GREEN
No AC power to all power supplies	OFF
AC cord unplugged or AC power lost; with a second power supply in parallel still with AC input power.	OFF
AC present / Only 12VSB on (Standby mode)	1Hz Blink GREEN
Power supply warning events where the power supply continues to operate; high temp, high current, slow fan.	1Hz Blink AMBER
Power supply critical event causing a shutdown; eg. OCP, OVP, OTP, Fan Fail	Solid AMBER
Power supply in FW upload mode	2Hz Blink GREEN

Table 6. LED Status

## 8.5 SIGNAL TIMING

OPERATING CONDITION	MIN	MAX	UNIT
$t_{AC\ VSB}$ AC Line to 90% $V_{SB}$		3	sec
$t_{AC\ V1}$ AC Line to 90% $V_1$		3	sec
$t_{ACOK\ on1}$ ACOK signal on delay (start-up)		1700	ms
$t_{ACOK\ on2}$ ACOK signal on delay (dips)	0	100	ms
$t_{V1\ holdup}$ Effective $V_1$ holdup time $P_o < 0.7 P_{x\ nom}$	10	300	ms
$t_{VSB\ holdup}$ Effective $V_{SB}$ holdup time $P_o < 0.7 P_{x\ nom}$	40	300	ms
$t_{ACOK\ V1}$ ACOK to $V_1$ holdup $P_o < 0.7 P_{x\ nom}$ ACOK to $V_1$ holdup $P_o > 0.7 P_{x\ nom}$	7 5		ms
$t_{ACOK\ VSB}$ ACOK to $V_{SB}$ holdup	25		ms
$t_{V1\ off}$ Minimum $V_1$ off time	500		ms
$t_{VSB\ off}$ Minimum $V_{SB}$ off time	500		ms
$t_{V1\ dropout}$ Minimum $V_1$ dropout time	10		ms
$t_{VSB\ dropout}$ Minimum $V_{SB}$ dropout time	40		ms
$t_{V1\ rise}$ $V_1$ rise time		30	ms
$t_{VSB\ rise}$ $V_{SB}$ rise time		30	ms
$t_{PSON\_L\ V1on}$ PSON_L to $V_1$ Delay (on)	5	400	ms
$t_{PSON\_L\ V1off}$ PSON_L to $V_1$ Delay (off)	0	100	ms
$t_{PWOK\ del}$ $V_1$ to PWOK Delay (on)	100	500	ms
$t_{PWOK\ warn}$ PWOK Delay (off) to $V_1 < 11.7\ V$ at $P_o < 0.7 P_{x\ nom}$ PWOK Delay (off) to $V_1 < 11.7\ V$ at $P_o > 0.7 P_{x\ nom}$	1 -1		ms

Table 7. Timing



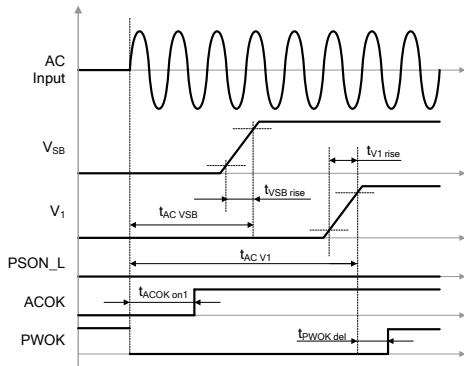


Figure 31. AC Turn-On Timing

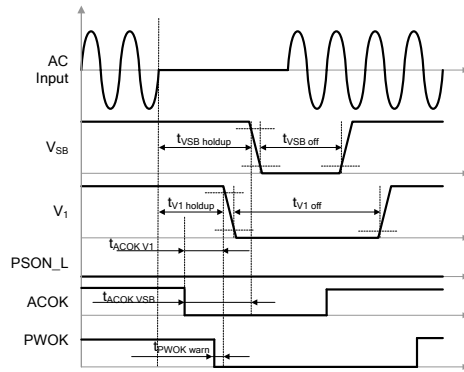


Figure 32. AC Long Dips

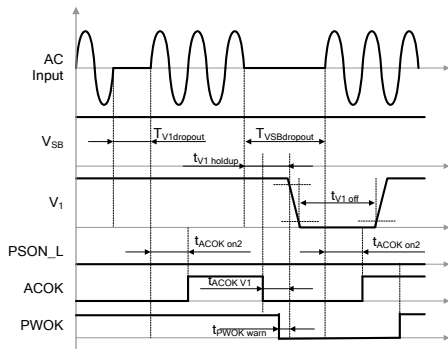


Figure 33. AC Short Dips

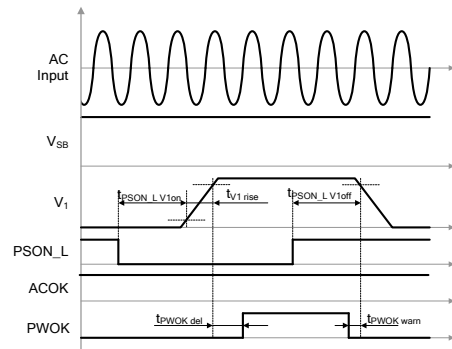


Figure 34. PSON\_L Turn-on/off Timing

8.6 I2C / POWER MANAGEMENT BUS COMMUNICATION

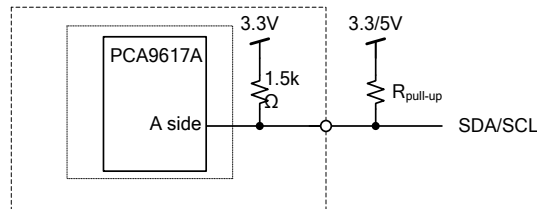


Figure 35. Physical Layer of Communication Interface

The TET front-end is a communication Slave device only; it never initiates messages on the I2C/SMBus by itself. The communication bus voltage and timing is defined in Table 8 further characterized through:

- The SDA/SCL IOs use 3V3 logic levels
- External pull-up resistors on SDA/SCL required for correct signal edges
- Full SMBus clock speed of 400 kbps
- Clock stretching limited to 1 ms
- SCL low time-out of >25 ms with recovery
- within 10 ms
- Recognizes any time Start/Stop bus conditions

Communication to the DSP or the EEPROM will be possible as long as the input AC voltage is provided. If no AC is present, communication to the unit is possible if it is connected to a life 12V or 12VSB output (provided e.g. by the redundant unit).





PARAMETER	DESCRIPTION	CONDITION	MIN	MAX	UNIT
<b>SCL / SDA</b>					
V <sub>IL</sub>	Input low voltage		-0.5	1.0	V
V <sub>IH</sub>	Input high voltage		2.3	3.5	V
V <sub>hys</sub>	Input hysteresis		0.15		V
V <sub>oL</sub>	Output low voltage	3 mA sink current	0	0.4	V
t <sub>r</sub>	Rise time for SDA and SCL		20+0.1C <sub>b</sub> <sup>1</sup>	300	ns
t <sub>of</sub>	Output fall time ViHmin → ViLmax	10 pF < C <sub>b</sub> <sup>1</sup> < 400 pF	20+0.1C <sub>b</sub> <sup>1</sup>	250	ns
I <sub>i</sub>	Input current SCL/SDA	0.1 VDD < Vi < 0.9 VDD	-10	10	μA
C <sub>i</sub>	Internal Capacitance for each SCL/SDA			0	pF
f <sub>SCL</sub>	SCL clock frequency		0	400	kHz
R <sub>pull-up</sub>	External pull-up resistor	f <sub>SCL</sub> ≤ 400 kHz		1000 ns / C <sub>b</sub> <sup>1</sup>	Ω
t <sub>HDSTA</sub>	Hold time (repeated) START	f <sub>SCL</sub> ≤ 400 kHz	0.6		μs
t <sub>LOW</sub>	Low period of the SCL clock	f <sub>SCL</sub> ≤ 400 kHz	1.3		μs
t <sub>HIGH</sub>	High period of the SCL clock	f <sub>SCL</sub> ≤ 400 kHz	0.6		μs
t <sub>SUSTA</sub>	Setup time for a repeated START	f <sub>SCL</sub> ≤ 400 kHz	0.6		μs
t <sub>HDDAT</sub>	Data hold time	f <sub>SCL</sub> ≤ 400 kHz	0	0.9	μs
t <sub>SUDAT</sub>	Data setup time	f <sub>SCL</sub> ≤ 400 kHz	100		ns
t <sub>SUSTO</sub>	Setup time for STOP condition	f <sub>SCL</sub> ≤ 400 kHz	0.6		μs
t <sub>BUF</sub>	Bus free time between STOP and START	f <sub>SCL</sub> ≤ 400 kHz	1		ms

<sup>1</sup> C<sub>b</sub> = Capacitance of bus line in pF, typically in the range of 10...400 pF

Table 8. I2C / SMBus Specification

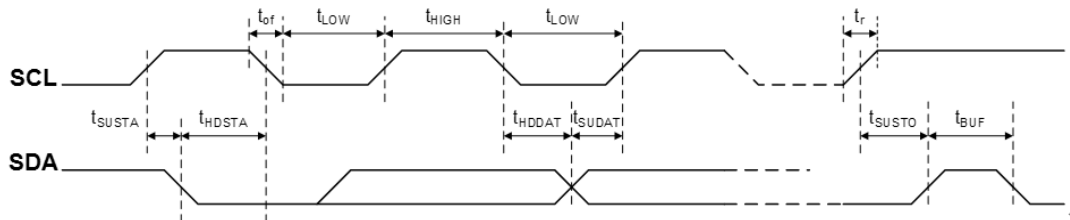


Figure 36. I2C / SMBus Timing

### ADDRESS SELECTION

The address for I2C communication can be configured by pulling address input pins A0,A1 and A2 either to GND (Logic Low) or leave them open (Logic High). An internal pull up resistor (10kohm) will cause the A0, A1 and A2 pin to be in High Level if left open. A fixed addressing offset exists between the Controller and the EEPROM.

### I2C ADDRESS

A2	A1	A0	I2C Address	
			Power Management Bus Address	EEPROM Address
0	0	0	0xB0	0xA0
0	0	1	0xB2	0xA2
0	1	0	0xB4	0xA4
0	1	1	0xB6	0xA6
1	0	0	0xB8	0xA8
1	0	1	0xBA	0xAA
1	1	0	0xBC	0xAC
1	1	1	0xBE	0xAE

Table 9. Address and Protocol Encoding



### 8.7 CONTROLLER AND EEPROM ACCESS

The controller and the EEPROM in the power supply share the same I2C bus physical layer (see *Figure 37*) and can be accessed under different addresses, see *Table 9 Address and Protocol Encoding*.

The SDA/SCL lines are connected directly to the controller and EEPROM which are supplied by internal 3V3.

The EEPROM provides 256 bytes of user memory. None of the bytes are used for the operation of the power supply.

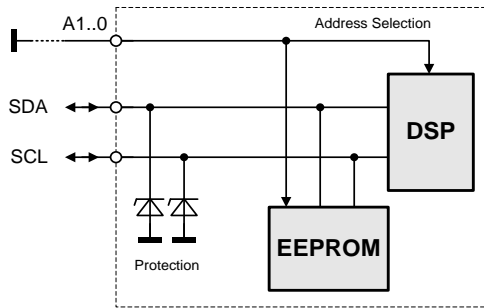


Figure 37. I2C Bus to DSP and EEPROM

### 8.8 EEPROM PROTOCOL

The EEPROM follows the industry communication protocols used for this type of device. Even though page write / read commands are defined, it is recommended to use the single byte write / read commands.


#### WRITE

The write command follows the SMBus 1.1 Write Byte protocol. After the device address with the write bit cleared a first byte with the data address to write to is sent followed by the data byte and the STOP condition. A new START condition on the bus should only occur after 1ms of the last STOP condition to allow the EEPROM to write the data into its memory.



#### READ

The read command follows the SMBus 1.1 Read Byte protocol. After the device address with the write bit cleared the data address byte is sent followed by a repeated start, the device address and the read bit set. The EEPROM will respond with the data byte at the specified location.




## 8.9 POWER MANAGEMENT BUS PROTOCOL

The Power Management Bus is an open standard protocol that defines means of communicating with power conversion and other devices. For more information, please see the System Management Interface Forum web site at: [www.powerSIG.org](http://www.powerSIG.org). Power Management Bus command codes are not register addresses. They describe a specific command to be executed. TET2500-12-086 Series supply supports the following basic command structures:

- Clock stretching limited to 1 ms
- SCL low time-out of >25 ms with recovery within 10 ms
- Recognized any time Start/Stop bus conditions


### WRITE

The write protocol is the SMBus 1.1 Write Byte/Word protocol. Note that the write protocol may end after the command byte or after the first data byte (Byte command) or then after sending 2 data bytes (Word command).




<sup>1)</sup> Optional

In addition, Block write commands are supported with a total maximum length of 255 bytes. See TET2500-12-086 Series Programming Manual for further information.




### READ

The read protocol is the SMBus 1.1 Read Byte/Word protocol. Note that the read protocol may request a single byte or word.



<sup>1)</sup> Optional

In addition, Block read commands are supported with a total maximum length of 255 bytes. See TET2500-12-086 Series Power Management Bus Communication Manual URP.00560 for further information.



9. MECHANICAL SPECIFICATIONS

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
Dimensions	Width		86		mm
	Height		40		
	Depth		195		
M	Weight		1.2		kg

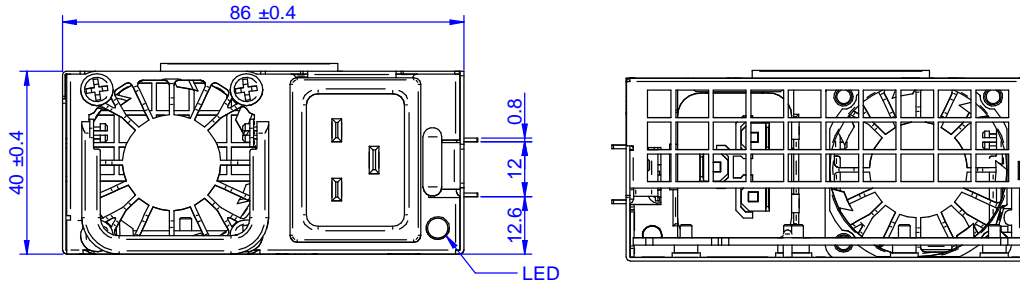


Figure 38. Mechanical Drawing - Front / Rear View

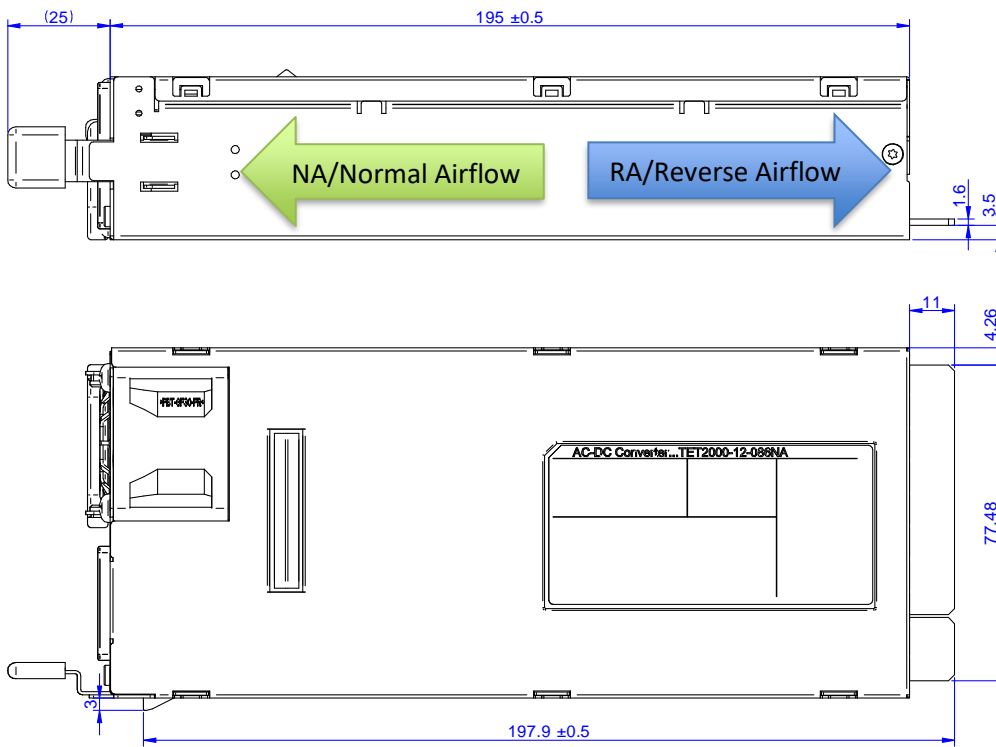


Figure 39. Mechanical Drawing - Side / Top View

**NOTE:** A 3D step file of the power supply casing is available on request.



## 10. TEMPERATURE AND FAN CONTROL

### 10.1 FAN CONTROL

To achieve best cooling results sufficient airflow through the supply must be ensured. Do not block or obstruct the air-flow at the rear of the supply by placing large objects directly at the output connector. The TET2500-12-086NA is provided with a rear to front airflow, which means the air enters through the DC-output of the supply and leaves at the AC-inlet and TET2500-12-086RA is reversed. The fan inside of the supply is controlled by a microprocessor. The rpm of the fan is adjusted to ensure optimal supply cooling and is a function of output power and the inlet temperature.

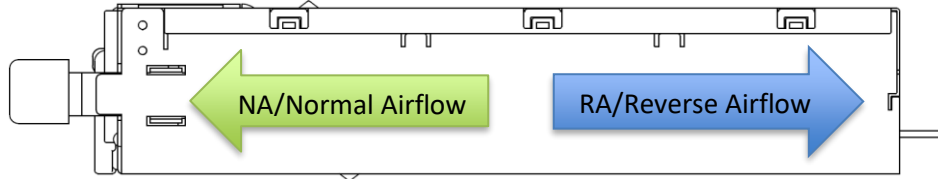


Figure 40. Airflow Direction

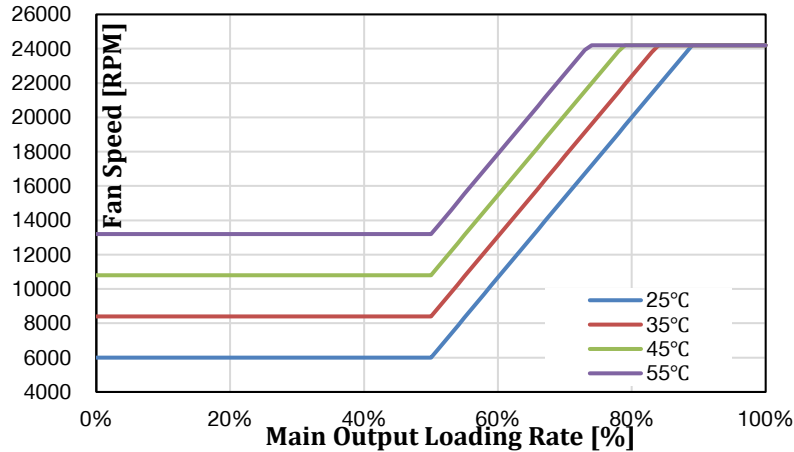


Figure 41. Fan Speed vs. Main Output Load

### 10.2 TEMPERATURE MONITOR AND OVER TEMPERATURE PROTECTION


The TET2500-12-086 Series provides access via I2C to the measured temperatures of in total 4 sensors within the power supply, see Table 10. The microprocessor is monitoring these temperatures and if warning threshold of one of these sensors is reached it will set fan to maximum speed. If temperatures continue to rise above shut down threshold the main output V1 (or VSB if auxiliary converter is affected) will be disabled. At the same time the warning or fault condition is signaled accordingly through LED, PWOK and SMB\_ALERT\_L.

TEMPERATURE SENSOR	DESCRIPTION / CONDITION	POWER MANAGEMENT BUS REGISTER	WARNING THRESHOLD	SHUT DOWN THRESHOLD
Inlet air temperature	Sensor located on control board close to DC end of power supply	0x8D	NA:57.5C RA:62C	NA:60C RA:65C
Oring Mosfet	Sensor located close to Oring Mosfet	0x8E	NA:100C RA:115C	NA:105C RA:120C
Outlet air temperature	Sensor located on main board close to AC front of power supply	0x8F	NA:85C RA:90C	NA:90C RA:95C
PFC&DC-DC heat sink	Sensor located on PFC heat sink		TBD	

Table 10. NA revision Temperature Sensor Location and Thresholds



### 10.3 TEMPERATURE MONITOR AND OVER TEMPERATURE PROTECTION

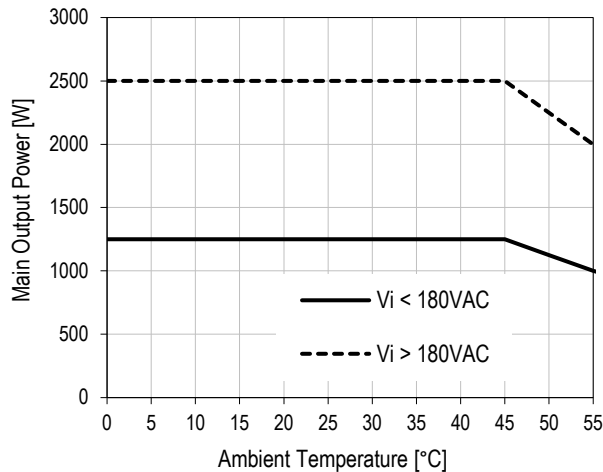

Vin (Vac)	45°C Pout_Nom (W)	50°C Pout_Nom (W)	55°C Pout_Nom (W)
90	1250	1125	1000
100	1250	1125	1000
110	1250	1125	1000
120	1250	1125	1000
130	1250	1125	1000
140	1250	1125	1000
150	1250	1125	1000
160	1250	1125	1000
170	1250	1125	1000
180	2500	2250	2000
190	2500	2250	2000
200	2500	2250	2000
210	2500	2250	2000
220	2500	2250	2000
270	2500	2250	2000

Figure 42. Output power VS Input voltage and inlet temperature

## 11. ELECTROMAGNETIC COMPATIBILITY

### 11.1 IMMUNITY

PARAMETER	DESCRIPTION / CONDITION	CRITERION
ESD Contact Discharge	IEC / EN 61000-4-2, ±8 kV, 25+25 discharges per test point (metallic case, LEDs, connector body)	A
ESD Air Discharge	IEC / EN 61000-4-2, ±15 kV, 25+25 discharges per test point (non-metallic user accessible surfaces)	A
Radiated Electromagnetics Filed	IEC / EN 61000-4-3, 10 V/m, 1 kHz/80% Amplitude Modulation, 1 µs Pulse Modulation, 10 kHz...2 GHz	A
Burst	IEC / EN 61000-4-4, level 3 AC port ±2 kV, 1 minute DC port ±1 kV, 1 minute	A
Surge	IEC / EN 61000-4-5 Line to earth: level 3, ±2 kV Line to line: level 2, ±1 kV	A
RF Conducted Immunity	IEC/EN 61000-4-6, Level 3, 10 Vrms, CW, 0.1 ... 80 MHz	A
Voltage Dips and Interruptions	IEC/EN 61000-4-11 1) Vi 230Volts, 70% Load, Dip 100%, Duration 10ms 2) Vi 230Volts, 100% Load, Dip 100%, Duration < 50 ms 3) Vi 230Volts, 100% Load, Dip 100%, Duration > 50 ms	A V1: B; VSB: A B

Table 11. Immunity

### 11.2 EMISSION

PARAMETER	DESCRIPTION / CONDITION	CRITERION
Conducted Emission	EN55022 / CISPR 22: 0.15 ... 30 MHz, QP and AVG	Class A
Radiated Emission	EN55022 / CISPR 22: 30 MHz ... 1 GHz, QP	Class A
Harmonic Emissions	IEC61000-3-2, Vin = 230 VAC, 50 Hz, 100% Load	Class A
AC Flicker	IEC / EN 61000-3-3, d <sub>max</sub> < 3.3%	Pass
Acoustical Noise	Sound power statistical declaration (ISO 9296, ISO 7779, IS9295) @ 50% load	50 dBA

Table 12. Emission



## 12. SAFETY / APPROVALS

Maximum electric strength testing is performed in the factory according to IEC/EN 62368-1, and UL/CSA 62368-1. Input-to-output electric strength tests should not be repeated in the field. Bel Power Solutions will not honor any warranty claims resulting from electric strength field tests.

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
Agency Approvals	UL 62368-1				
	CAN/CSA-C22.2 No. 62368-1				
	IEC 62368-1				
	EN 62368-1				
Isolation Strength	Input (L/N) to case (PE)				Basic
	Input (L/N) to output				Reinforced
Creepage / Clearance	Primary (L/N) to protective earth (PE)	3.0			mm
	Primary to secondary	6.0			
Electrical Strength Test	Input to case	2.5			kVDC
	Input to output	4.0			

Table 13. Safety/Approvals

## 13. ENVIRONMENTAL

Power supply shall meet the thermal requirements under the load and environmental condition identified in each table. Even though the table addresses only the exhaust air temperature, all other components in the power supply shall also meet their temperature specifications and lifetime requirements.

The power supply must meet UL enclosure requirements for temperature rise limits. All sides of the power supply with exception to the air exhaust side must be classified as “Handle, knobs, grips, etc. held for short periods of time only”.

In case the exit air temperature requirement cannot be met, the power supply must have a warning label for high touch temperature in compliance with IEC/UL 60950-1 and additionally 85C rated power cords must also be used with this power supply.

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
$T_A$ Ambient Temperature	$V_{I\ min}$ to $V_{I\ max}$ , $I_{I\ nom}$ , $I_{SB\ nom}$ at 5000 m	0		+40	°C
	$V_{I\ min}$ to $V_{I\ max}$ , $I_{I\ nom}$ , $I_{SB\ nom}$ at 2000 m	0		+45	°C
$T_{A\ ext}$ Extended Temp. Range	Derated output at 2000 m	+45		+55	°C
$T_S$ Storage Temperature	Non-operational	-40		+70	°C
Altitude	Operational, above Sea Level (see derating)	-		5000	m

Table 14. Operation Environmental



## 14. CONNECTIONS

The AC input receptacle shall be a 3 pins IEC320 C20 inlet.

For the pin assignment of DC connector, please refer to *Figure 43* and *Table 15*.

The Mating connector should be FCI 10121510-480020ALF

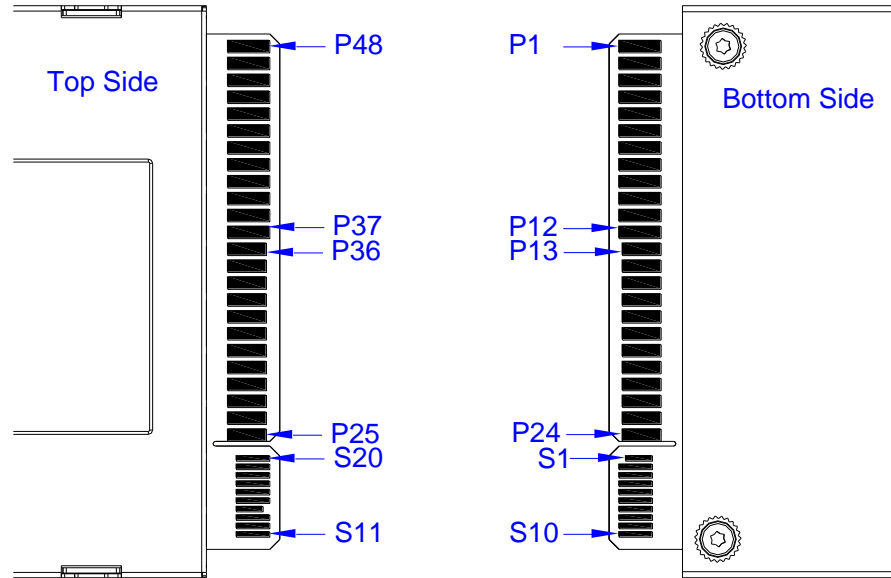


Figure 43. Pin Assignment of DC Connector

PIN	NAME	DESCRIPTION
P13-24, P25-36	V1	+12 VDC main output
P1-12, P37-48	PGND	+12 VDC main output ground
S1	PSKILL	Power supply kill (trailing pin) <sup>8)</sup> : active-high
S2	ACOK	AC input OK signal: active-high
S3	SDA	I <sup>2</sup> C DATA I <sup>2</sup> C data signal line
S4	SCL	I <sup>2</sup> C CLOCK I <sup>2</sup> C clock signal line
S5	ISHARE	12 V Load Share V <sub>1</sub> Current share bus
S6	A0	I <sup>2</sup> C Address I <sup>2</sup> C address selection input
S7	A1	I <sup>2</sup> C Address I <sup>2</sup> C address selection input
S8	PWOK	Power OK signal output: active-high
S9	A2	I <sup>2</sup> C address selection input
S10	EEPROM_WP	EEPROM write protect
S11	SGND	Signal ground <sup>9)</sup> (return)
S12	PSON_L	Power supply on input: active-low
S13	SMB_ALERT_L	SMB Alert signal output: active-low
S14	PRESENT_L	Power supply present (trailing pin): active-low
S15-16	VSB_GND	Standby Ground <sup>8)</sup>
S17-18	VSB	Standby positive output
S19	V1_SENSE-	Main output negative sense
S20	V1_SENSE+	Main output positive sense

<sup>8)</sup> This pin should be connected to SGND on the system

<sup>9)</sup> This pin should be connected to PGND on the system



All signal pins are referred to SGND

Table 15. Connector pin assignment





## 15. ACCESSORIES

ITEM	DESCRIPTION	ORDERING PART NUMBER	SOURCE
	<b>I<sup>2</sup>C Utility</b> Windows XP/Vista/7 compatible GUI to program, control and monitor TET2500-12-086NA/RA Front-Ends (and other I <sup>2</sup> C units)	N/A	<a href="http://befuse.com/lpower-solutions">befuse.com/lpower-solutions</a>
	<b>Single Connector Board</b> Connector board to operate TET2500-12-086NA/RA unit. Includes an on-board USB to I <sup>2</sup> C converter (use I <sup>2</sup> C Utility as desktop software).	YTM.G1Z01.0	<a href="http://befuse.com/lpower-solutions">befuse.com/lpower-solutions</a>

## 16. REVISION HISTORY

REVISION	DESCRIPTION OF CHANGES	DATE	ORIGINATOR	ECO/MCO REFERENCE NO
001	Initial release	2018-08-06	Jun Li	
002	1) Disclaimer on the first page was removed 2) PMBus needs to be fully spelled out every time it is used: Power Management Bus 3) No trademark symbols used with Power Management Bus	2019-03-29	V. Stefancova	
003	1) Changed <i>t<sub>VI</sub> off</i> and <i>t<sub>VB</sub> off</i> from 1000ms to 500ms min in section 8.5 page 15 2) Changed <i>t<sub>VI</sub> holdup</i> , <i>t<sub>VB</sub> holdup</i> and <i>A<sub>COOK</sub> V<sub>I</sub></i> testing conditions and limits in section 8.5 page 15 3) Add ACCESSORIES information in Section 15 page 25 4) Change Electrical Strength Test Input to case voltage from 2.8 to 2.1 kVDC in section 12 page 23	2019-06-18	Jun.li	
AA	1) Release to AA	2019-07-29	WF	C94884
AB	1) Change the description to “Best-in-class, Meet Titanium efficiency” at page 1 2) Update the safety approve standard and electrical strength test at section 12	2023-08-23	Chad Cai	

**For more information on these products consult: [tech.support@psbel.com](mailto:tech.support@psbel.com)**

**NUCLEAR AND MEDICAL APPLICATIONS** - Products are not designed or intended for use as critical components in life support systems, equipment used in hazardous environments, or nuclear control systems.

**TECHNICAL REVISIONS** - The appearance of products, including safety agency certifications pictured on labels, may change depending on the date manufactured. Specifications are subject to change without notice.



**Asia-Pacific**  
+86 755 298 85888

**Europe, Middle East**  
+353 61 49 8941

**North America**  
+1 866 513 2839